

# MUI TANK


FRP STORNGE TANK



### **WHY US?**


- Non-Toxic
- Rust Free
- Seamless
- Sun light resistant
- Storage for cold water or chemical

# Open Top Series

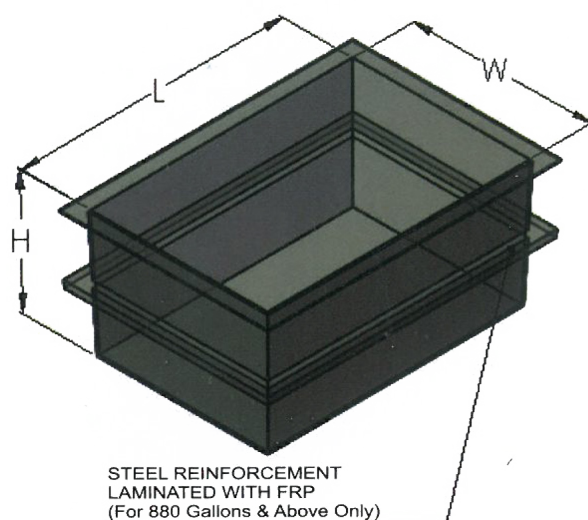


Mui Tank properties - Square Tank						
CAPACITY		MODEL	INTERNAL DIMENSION			THICKNESS
Gallons	Litres		L	W	H	
220	1000	MT-220	1 M	1 M	1 M	4 mm
440	2000	MT-440	2 M	1 M	1 M	4 mm
660	3000	MT-660	3 M	1 M	1 M	5 mm
880	4000	MT-880	2 M	2 M	1 M	6 mm
1320	6000	MT-1320	3 M	2 M	1 M	7 mm
1760	8000	MT-1760	2 M	2 M	2 M	8 mm


# Open Top Series

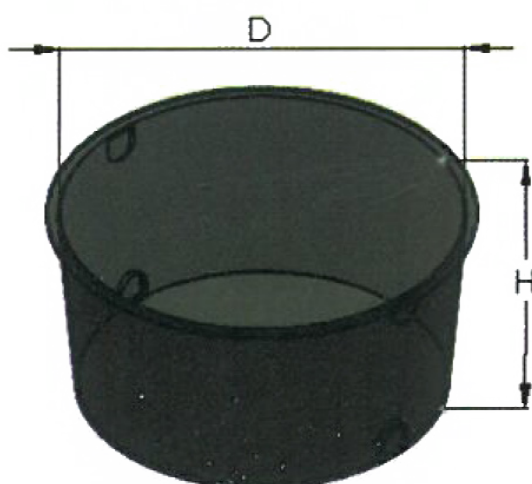


Mui Tank properties - Circular Tank					
CAPACITY		MODEL	INTERNAL DIMENSION (DxH)		THICKNESS
Gallons	Litres				
220	1000	MT-220/C	1.35M	1M	4 mm
440	2000	MT-440/C	1.70M	1M	4 mm
660	3000	MT-660/C	2.00M	1M	5 mm
880	4000	MT-880/C	2.32M	1M	6 mm

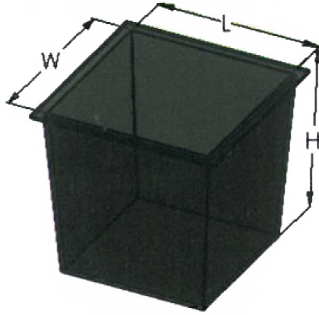

FOR MT60 to 100 MODEL

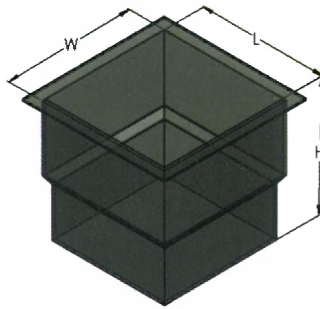


FOR MTD MODEL

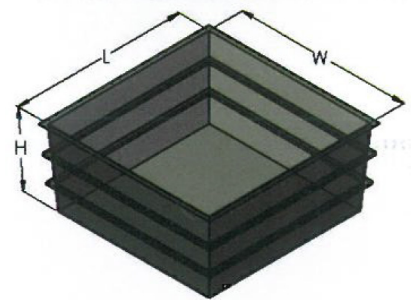

FOR MT250 to 400 MODEL

Mui Tank properties - Square Tank					
CAPACITY		MODEL	INTERNAL DIMENSION		
Gallons	Litres		L	W	H
60	270	MT-60	29"	29"	20"
80	360	MT-80	39"	31"	20"
100	450	MT-100	38"	32"	23"
150	680	MTD-150	48"	36"	24"
200	910	MTD-200	48"	48"	24"
250	1140	MTD-250	60"	48"	24"
250	1140	MT-250	48"	48"	30"
300	1360	MT-300	51"	51"	32"
400	1820	MT-400	48"	48"	48"

# Closed Top Series

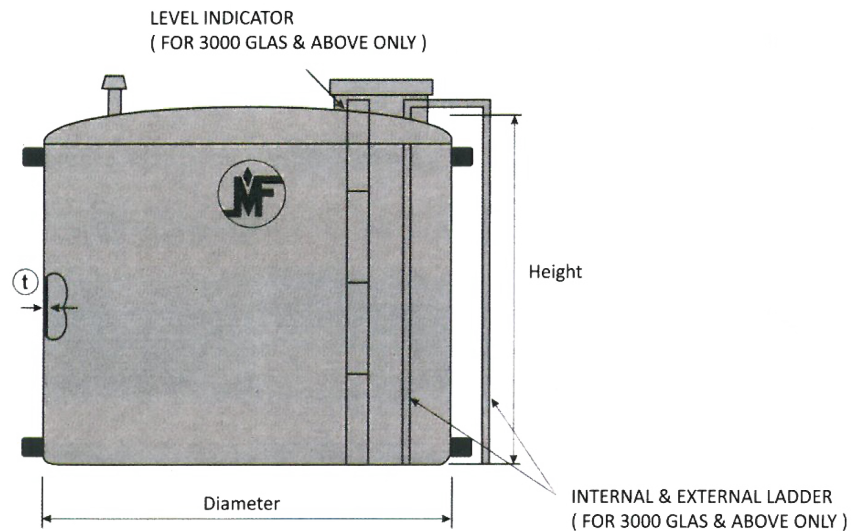

PHYSICAL PROPERTIES OF FRP		RESULT	JIS A4110-1989/MS 1241 : 1991
Tensile strength	(MN/m <sup>2</sup> )	103.0	70 (min)
Bending strength	(MN/m <sup>2</sup> )	182.4	100 (min)
Elastic modulus in bend	(MN/m <sup>2</sup> )	7906.0	6000 (min)
Barcol (Hardness)	Barcol	50	Moulded surface 58 (max) 43 (min)
			Moulded surface 62 (max) 42 (min)
Water absorption	%	0.15	1.0 (max)
Lap shear strength	(MN/m <sup>2</sup> )	11.03	7.0 (min)

## Note:

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacurer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.




### Diameter 1.2m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,000	250	54	5 ~ 6
1,200	300	60	5 ~ 6
1,610	400	72	5 ~ 6
2,010	500	96	5 ~ 6
2,410	600	110	5 ~ 6
# 3,000	750	131	5 ~ 6

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

# Closed Top Series

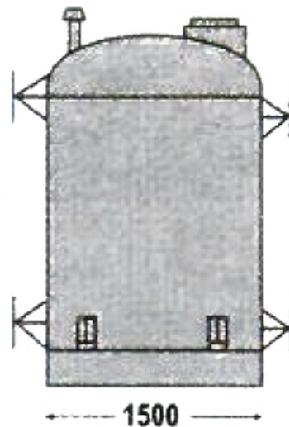

## Diameter 1.5m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,030	400	76	5 ~ 6
1,280	500	95	5 ~ 6
1,540	600	107	5 ~ 6
1,800	700	118	5 ~ 6
2,060	800	130	5 ~ 6
2,570	1,000	152	5 ~ 6
3,080	1,200	178	5 ~ 7
# 3,750	1,460	211	5 ~ 8

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.






### Diameter 2.0m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,010	700	128	5 ~ 6
1,160	800	136	5 ~ 6
1,440	1,000	153	5 ~ 6
2,170	1,500	208	5 ~ 8
2,890	2,000	286	6 ~ 8
3,610	2,500	336	6 ~ 8
4,330	3,000	429	6 ~ 8
# 5,000	3,460	544	7 ~ 9

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

# Closed Top Series

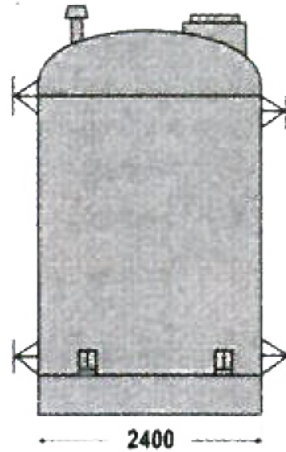


## Diameter 2.4m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,000	1,000	169	5 ~ 6
1,510	1,500	221	5 ~ 6
2,010	2,000	290	6 ~ 8
2,510	2,500	332	6 ~ 8
3,010	3,000	404	6 ~ 8
4,010	4,000	562	7 ~ 9
5,020	5,000	728	7 ~ 9
# 6,000	5,980	851	7 ~ 10

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

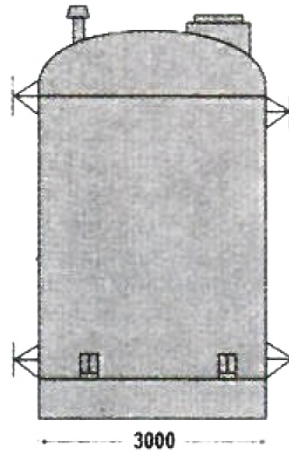


### Diameter 3.0m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,280	2,000	326	6 ~ 8
1,930	3,000	412	6 ~ 8
2,570	4,000	551	7 ~ 9
3,210	5,000	681	7 ~ 9
3,850	6,000	786	7 ~ 10
5,140	8,000	1,178	8 ~ 13
6,420	10,000	1,399	8 ~ 13
# 7,500	11,680	1,711	8 ~ 14

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

# Closed Top Series

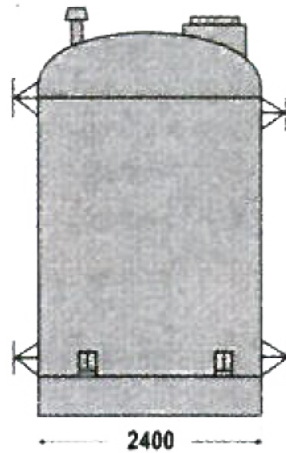


## Diameter 4.0m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,810	5,000	732	7 ~ 9
2,170	6,000	823	7 ~ 10
2,530	7,000	990	8 ~ 11
2,890	8,000	1,168	8 ~ 13
3,610	10,000	1,332	8 ~ 13
4,330	12,000	1,604	8 ~ 14
5,420	15,000	1,874	8 ~ 14
6,500	18,000	2,471	9 ~ 16
7,220	20,000	2,870	10 ~ 17
9,030	25,000	3,855	11 ~ 19
# 10,000	27,680	4,439	12 ~ 20

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

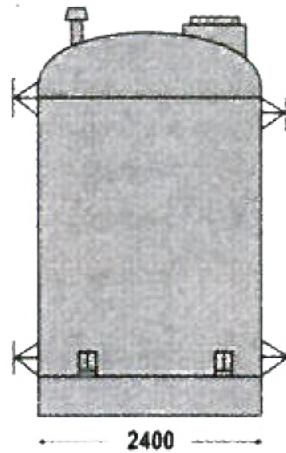

### Diameter 5.0m series


Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,020	4,400	450	5
2,050	8,800	650	7
3,060	13,200	850	9
24,080	17,600	1050	10
5,100	22,000	1250	11
# 6,120	26,400	1450	12

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

\* Diameter 5m, 6m and 7m water tank to be assemble/fabricate at site.

# Closed Top Series

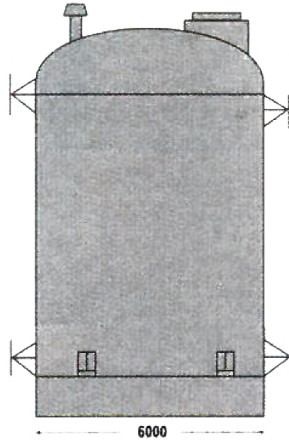


## Diameter 6.0m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,070	6,600	600	5
2,130	13,200	900	7
3,190	19,800	1,150	9
4,250	26,400	1,500	11
5,310	33,000	1,800	13
# 6,370	39,600	2,050	15

# Maximum height of each diameters.

- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

\* Diameter 5m, 6m and 7m water tank to be assemble/fabricate at site.

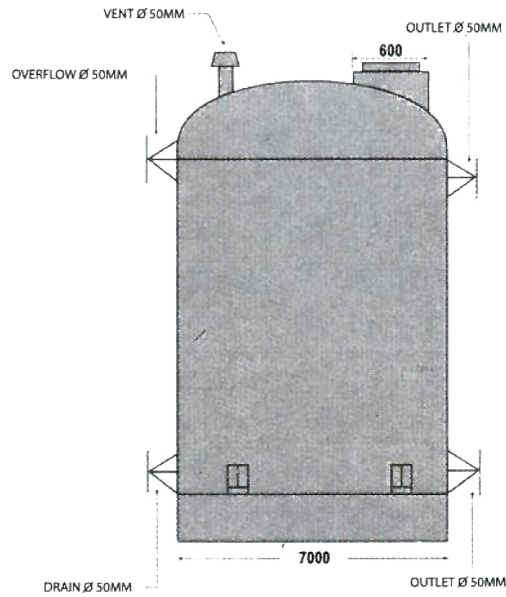

### Diameter 7.0m series

Height (mm)	Capacity (Gallons)	Approx. Weight (Kg)	Approx. Thickness (mm)
1,040	8,800	750	5
2,080	17,600	1,050	7
3,120	26,400	1,500	10
4,160	35,200	1,900	12
5,200	44,000	2,350	14
# 6,240	52,800	2,800	16

# Maximum height of each diameters.


- All dimension are rounded-off to the nearest 10mm (or 0.5 inch)
- Only water tanks which 3000 Gallons and above will be supplied with internal/external ladder and level indicator.
- The manufacturer reserves the right to amend or change the design, patterns and specifications without any prior notice as continuous improvement achieved.

\* Diameter 5m, 6m and 7m water tank to be assemble/fabricate at site.

# Open Top Series

## Installation Instruction

1. The centre-line of the Ball-Valve should be approximately 38mm from top of the tank.
2. A backing plate must be used and fitted on the outside of the tank.
3. Place the tank on top a flat supporter, e.g. flat plywood or concrete at 90 degree angle vertically for a uniform pressure support over the tanks entire base.
4. Support and align all pipes connecting to the tank **DO NOT OVERTIGHTENED THE BACKNUT AGAINST THE FIBER-GLASS TANK.**
5. Use only plastic, rubber washers and PTFE tapes when connecting and joining pipes and other attachments to the fiberglass tank. **DO USE PUTTY OR ANY FORM OF JOINTING COMPOUND.**
6. Only make fixing pipe circular hole clean edged and notch-free by using sharp hollow punch, hole saw or sharp driller or other sharp cutter that makes perfect circular hole. Scoring or scratching the tank should not be used for setting out the holes.
7. Only position and make water outlet within in the flat corner or base portion.
8. When cascading tank is necessary only links the tanks as diagram.
9. **DO NOT PLACED THE TANK NEAR A HEATER, ELECTRICAL LIGHT BULB OR OTHER SOURCE OF HEAT.**
10. Always use the right size lid as recommended.

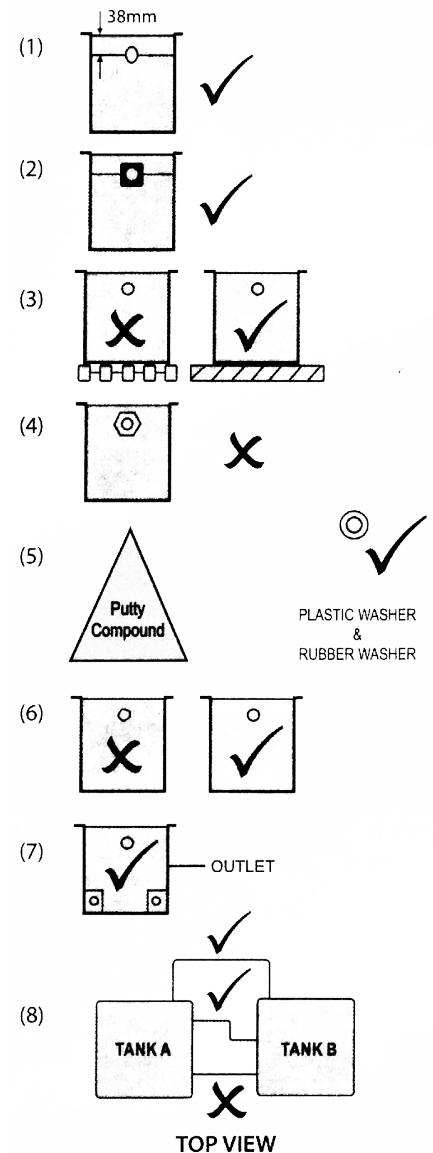

## Warranty Terms & Conditions :


1. 8 years (outdoor) and/or 10 years (indoor) warranty covers Mui Tank MS 1241 : 1991 / JIS A4100 : 1989 for cold water storage only unless otherwise specified.
2. We shall not be held responsible for any defects or damages to the tanks if above installation instructions are not adhered to.
3. Our liability is strictly limited to replacing the water tanks. The company will not be responsible for any consequence or losses resulting from the tanks.
4. our Mui Tanks are used for cold water storing on elevated even as clause No 3



# Closed Top Series

## Installation Instruction

1. Mui tanks should be lifted / unloaded using crane or similar by using ropes or nylons slings to lifting lugs provided NOT lifting at side fittings.

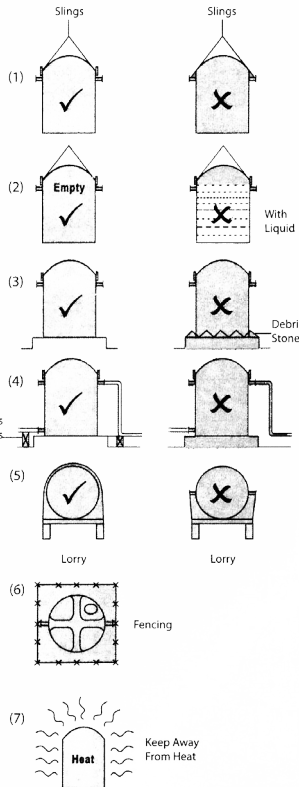

2. Mui Tanks can only be lifted when the tank is empty of liquid/water.
3. Mui Tanks should be placed on an elevated even surface, such as concrete platform at least 10 inch (250mm) height from ground level, free of debris or stones.
4. After Mui Tanks have been positioned all piping and jointing must be supported with steel/concrete footing.
5. After lift /loading using crane to the lorry/low loader, tanks must be safeguarded by wrapping slings around the body of tanks. Strictly NOT on pipes fitting.
6. Mui Tanks surrounding area should have fencing to prohibit unauthorized person's incidents eg. Strike on tanks with hammer, spanner or sharp object.
7. Mui Tanks should not be placed near heater, electric light bulb or other source of heat.

### Warranty Terms & Conditions :

1. 8 years (outdoor) and/or 10 years (indoor) warranty covers Mui Tank MS 1241 : 1991 / JIS A4100 : 1989 for cold water storage only unless otherwise specified.
2. We shall not be held responsible for any defects or damages to the tanks if above installation instructions are not adhered to.
3. Our liability is strictly limited to replacing the water tanks. The company will not be responsible for any consequence or losses resulting from the tanks.
4. Our Mui Tanks are used for cold water storing on elevated even as clause No 3

Authorised Distributor :

**Joncan**  
Commercial Furniture Specialist

MARKETING  
OFFICE

69-01, JALAN IMPIAN EMAS 22,  
TAMAN IMPIAN EMAS,  
81300 SKUDAI, JOHOR,  
MALAYSIA.

[www.joncan-furniture.com](http://www.joncan-furniture.com)

Tel: 07-554 7816

Fax: 07-557 5994

Email: [joncanfrp@yahoo.com](mailto:joncanfrp@yahoo.com)